



Thermal-Hydraulic behavior of the Spent Fuel Pool

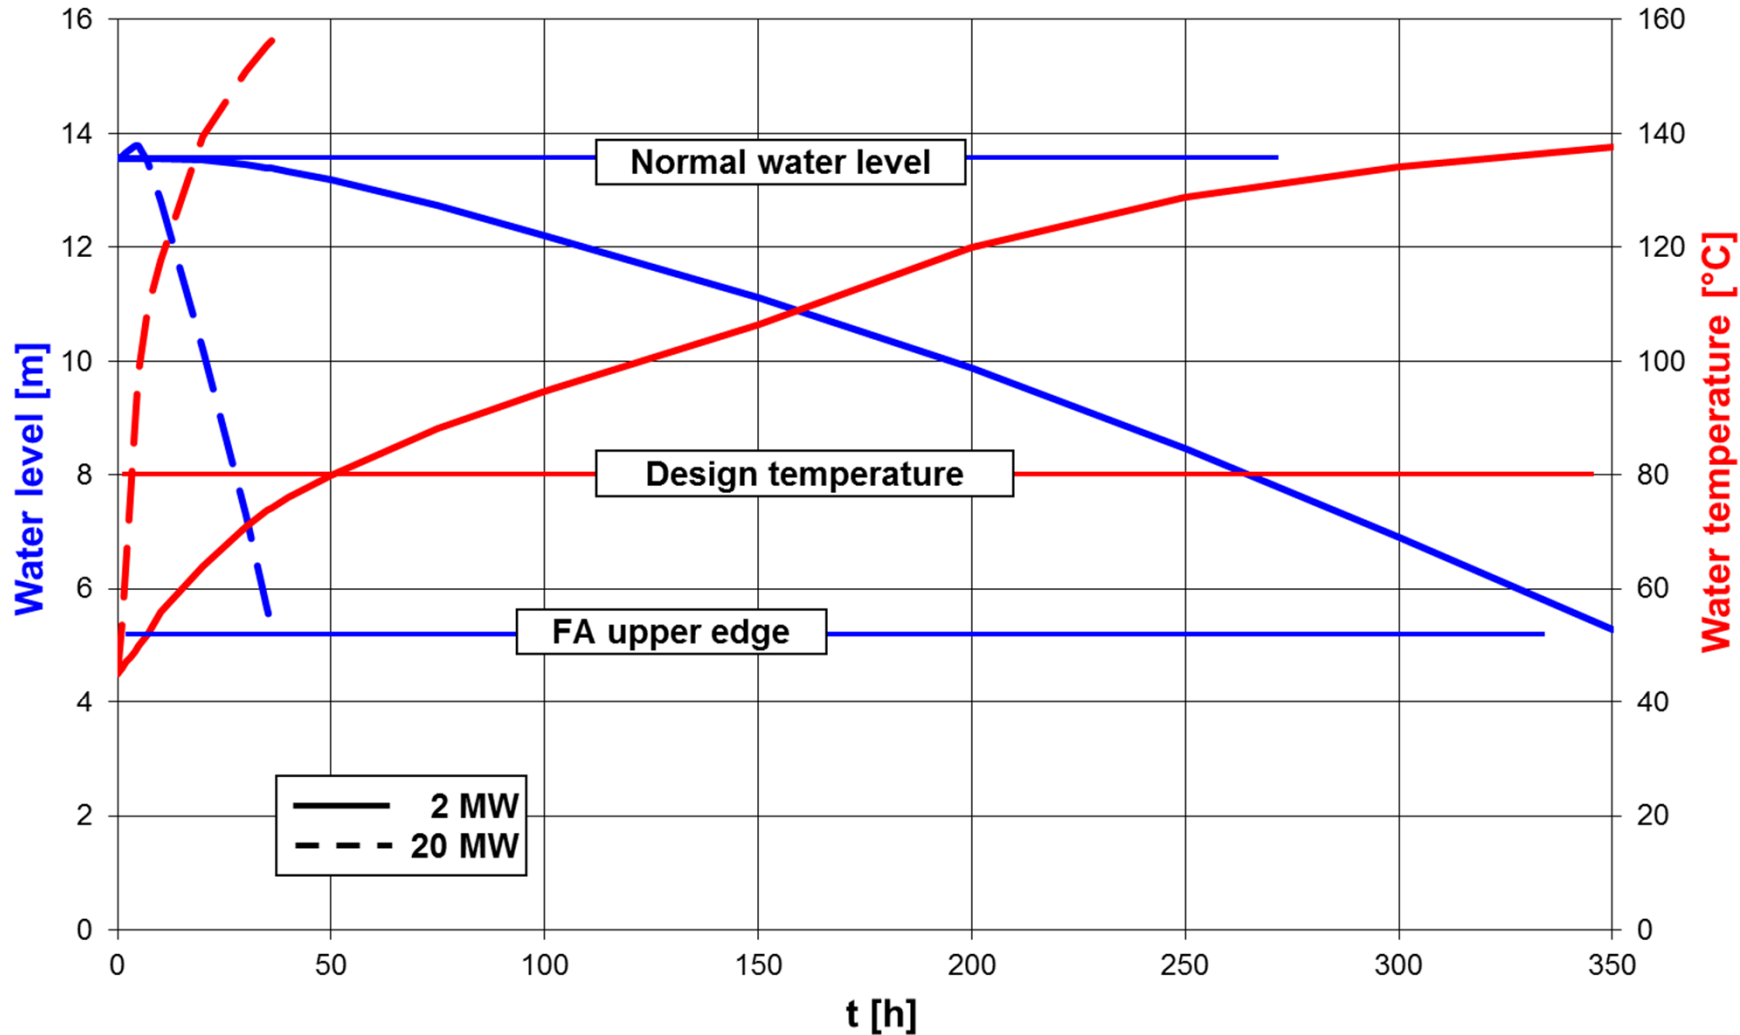

- ▶ Fuel assemblies exposed after 34 h (full core offload) resp. 14 d (power operation)
- ▶ Design temperature of SFP exceeded after 3 h (full core offload) resp. 48 h (power operation)

Thermal-Hydraulic behavior of the Containment

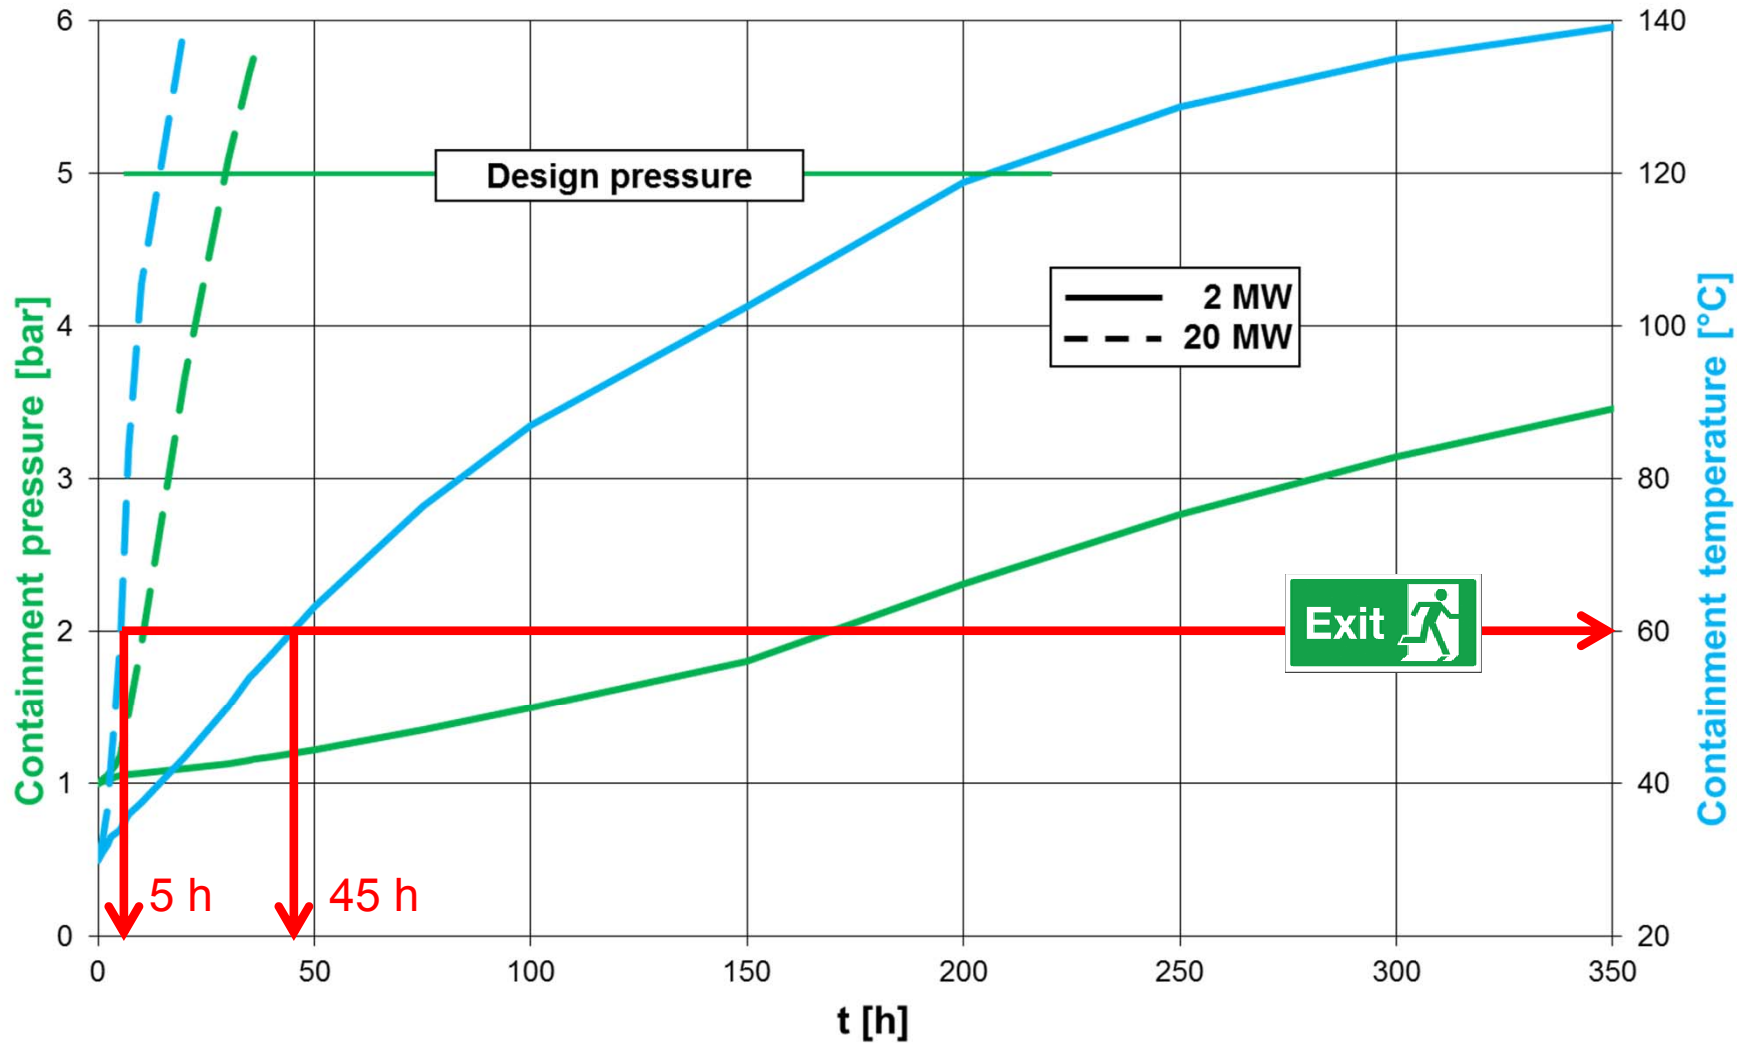

- ▶ Containment inaccessible after 5 h (full core offload) resp. 45 h (power operation)
- ▶ Pressure release necessary after 29 h (full core offload)